

PROPOSAL

Costa Mesa SA 2026-2030

PREPARED BY

Siemens Industry, Inc. ("Siemens")

PREPARED FOR

CITY OF COSTA MESA

DELIVERED ON

May 11, 2026

SMART BUILDINGS

Transforming the Everyday



Table of Contents

- INTRODUCTION 1
 - Proposal Information 1
 - Contact Information 3

- CUSTOMER OVERVIEW 5
 - Executive Summary 5
 - Siemens Capabilities & Customer Commitment 6

- SERVICE SOLUTION 7
 - Building Services – Automation 7
 - Emergency Response Times – Automation 9
 - Building Services – Mechanical 10
 - Emergency Response Times – Mechanical 14
 - Equipment Inventory 15
 - Exclusions and Clarifications 28

- SERVICE IMPLEMENTATION PLAN 29
 - Connectivity and Communications 29
 - Service Agreement Contract Characteristics 30
 - Equipment Related Services 31
 - General Services 51
 - Service Team 52

- TERMS OF SALE 53
 - Siemens Terms of Sale (STS) 53
 - Agreement Terms for Investments 54

- SIGNATURE PAGE 56
 - Signature Page 56

- APPENDICES 57
 - Siemens Service Portfolio 57

Contact Information

Proposal #:	10550946
Date:	May 11, 2026

Sales Executive:	Kris Gilmour
Branch Address:	6141 Katella Ave. Cypress, CA, CA 90630
Telephone:	(657)-465-1813
Email Address:	kris.gilmour@siemens.com

Customer Contact:	Tung Vo
Customer:	CITY OF COSTA MESA
Address:	77 FAIR DR
	COSTA MESA CA 92626-6520
Services shall be provided at:	CITY OF COSTA MESA
	77 FAIR DR COSTA MESA CA 92626-6520

Sourcewell Account: City of Costa Mesa

Account # 2173

Sourcewell Contract #080824-SIE

50bffc94-ea77-4284-822b-ae5400af53a2

Executive Summary

Customer Needs

The Services proposed in this agreement are specifically designed for CITY OF COSTA MESA, and the services provided herein will help you in achieving your facility goals.

Services Included

Siemens will provide the following services.

Service Description

- Customer Directed Support
- Customer Directed Support
- Annual Inspection
- Operational Inspection
- Condenser Tube Cleaning (water)
- Vibration Analysis
- Eddy Current Analysis
- User Defined Equipment Independent Service
- Air Filter Service
- Belt Service
- Coil Cleaning - Condenser (Refrig)
- Cooling Tower Cleaning
- Combustion Analysis
- Apogee System
- Apogee System
- Apogee P2
- Insight Workstation
- Control Loop Tuning
- Apogee System

Siemens Capabilities & Customer Commitment

Siemens Industry, Inc. is a leading single-source provider of cost-effective facility performance solutions for the comfort, life safety, security, energy efficiency and operation of some of the most technically advanced buildings in the world. For more than 150 years, Siemens has built a culture of long-term commitment to customers through innovation and technology. Siemens is a financially strong global organization with a Branch network that delivers personalized service and support to customers in multiple industries and locations.

References are available upon request.

Building Services – Automation

Services that deliver the outcomes you want to achieve

Services delivered by Siemens have been developed to help you achieve the outcomes you expect.

Network Health

Optimize the health of the network infrastructure by analyzing network traffic and resolving performance issues.

Network Maintenance Report

Network Maintenance: Using a combination of proprietary diagnostic technologies, digital meters, and network analysis software, Siemens will analyze, optimize and report on the performance of the customer's systems networks a specified number of times per year. Proper network performance helps to ensure the proper speed of communication and accuracy of control, alarming, and reporting across the facility. Using network diagnostic tools, our proactive evaluation of the data network includes an analysis of bandwidth, disturbances, network traffic, communication over the network, and overall operation. The number of networks to be analyzed and the frequency of the service are documented in the List of Equipment Related Services.

Additional Services

Control Loop Tuning

Control loops drift out of calibration with changes in mechanical efficiency, building use, and climatic conditions. Through this service Siemens will ensure control loops for devices such as valves, dampers, actuators, etc., experience minimized overshooting and oscillatory behavior. The control loops to be included as part of this service are itemized in the List of Equipment Related Services in this service agreement.

Preventive Maintenance – Automation (12 Days are included)

We will provide preventive maintenance in accordance with a program of routines as determined by our experience, equipment application and location. The list of field panels and/or devices included under this service are identified in the List of Equipment Related Services in this service agreement.

Automation controls can drift out of calibration with changes in HVAC component performance characteristics, building use, and climatic conditions. This service will extend equipment life, reduce energy consumption, and reduce the risk of costly and disruptive breakdowns.

Software Maintenance

Using appropriate tools from Siemens' suite of diagnostic tools, we periodically perform system diagnostics and then take corrective actions to ensure that the Building Automation System is performing at peak efficiency or to customer requirements. We make sure that software changes are clear and consistent, address any failed points, points in alarm, points in operator priority and take corrective action. We identify

and correct software corruption and inconsistencies; eliminate duplicate points, redundant loops and causes of unnecessary traffic; and address unresolved points and alarm reporting problems. This will ensure that the system operates quickly, accurately and efficiently as originally designed and installed or as determined by current standards or requirements.

Customer Directed Support (20 hours are included)

With Customer Directed Support, Siemens will provide a trained and experienced specialist or technician who will work under your direction. The intent of this service is to offer you labor assistance in completing a special project, or to meet a facility objective. Specific job responsibilities, goals, work hours and other associated deliverables of this service are listed in the Appendix section of this service agreement.

Emergency Response Times – Automation

Emergency Online/Phone Response

Billable Service

Online system and software troubleshooting and diagnostics and phone support will not be provided under the coverage of this agreement. Siemens will respond to your request for emergency on-line/phone support, Mon-Fri 8:00AM-5:00PM, excluding holidays, upon receiving notification of an emergency, as determined by your staff and Siemens, but all service performed will be provided as a billable service. If remote diagnostics determine a site visit is required to resolve the problem, a technician can be dispatched. Depending on your contract coverage, the on-site dispatch will be covered or will be a billable service call.

Emergency On-site Response

Billable Service

Emergency Onsite Response is not included within the coverage of this agreement. Siemens will respond to your request for emergency on-site service as soon as staff is available. An emergency is determined by your staff and Siemens. All service performed will be provided as a billable service. Siemens will respond to your request for emergency onsite support, Mon-Fri 8:00AM-5:00PM, excluding holidays, upon receiving notification of an emergency, as determined by your staff and Siemens, but all service performed will be provided as a billable service.

Building Services – Mechanical

Services that deliver the outcomes you want to achieve.

Services delivered by Siemens have been developed to help you achieve the outcomes you expect.

Air Filter Service

Through this service Siemens will maintain indoor air quality by changing filters and minimizing dust and particles from collecting in the ductwork. This service also helps ensure proper flow through cooling and heating coils thus helping to prevent restrictions in airflow and provide better heat transfer, leading to better system performance and energy efficiency. The air handling equipment in which this air filter service is included is identified in the Mechanical Equipment List. Any filters that require replacement on a frequency other than the scheduled operational or annual service visits will be specifically identified immediately following this paragraph. In the event the air filter service or cleaning requires different frequencies than indicated (due to experience or changes in operating conditions), recommendations will be made for your approval to adjust the frequencies and any associated price.

Annual Inspection

Siemens will perform scheduled annual preventive maintenance in accordance with a program of standard routines as determined by our experience, equipment application, and equipment operating hours that are recommended by each equipment manufacturer and location. This service is designed to optimize the reliability and efficiency of the equipment, and provide you with possible indications of excessive wear and damage to your systems before a catastrophic failure occurs. Depending on our findings we will also provide recommendations for additional service(s) that will help to better enhance equipment performance and / or report any other deficiencies that are not corrected within the scope of this agreement. The equipment included under this service is itemized in the Mechanical Equipment List in this service agreement.

Belt Service

Siemens will provide necessary labor and material to change the belt(s) on the listed equipment. The belts will be changed during annual or seasonal inspections once per year

Coil Cleaning - Condenser (Refrigeration)

Through this service Siemens will improve airflow across condenser coils and improve heat transfer. This service will help to extend the life of the compressors and improve efficiency. Coil cleaning consists of cleaning the outside surface of the condensing unit coils to remove any airborne particles, or dirt buildup by using a brush, high pressure air, chemical with low pressure wash or chemical with high pressure wash at our discretion based on the condition of the outside environment and coil accessibility. The equipment included under this service is itemized in the Mechanical Equipment List in this service agreement. Any Coils that require cleaning on a frequency other than the scheduled operational or annual service visits will be specifically identified immediately following this paragraph.

Condenser Tube Cleaning

Siemens will provide necessary labor and material to remove the condenser head and manually clean the condenser tubes with the appropriate cleaning equipment and replace the condenser head when cleaning is completed. This is done to maximize heat transfer which should result in efficiently operating equipment. The condenser tubes will be cleaned during normal hours at a time that is mutually agreeable between your staff and Siemens. Acid washing to remove excessive scale build up due to poor water treatment is not included with this service.

Cooling Tower Cleaning

Siemens will drain, clean and remove normal debris from the cooling tower basins and distribution pans. This provides for even water flow and reduces the likelihood that debris will enter the condenser water system that could block chiller condenser tubes and restrict condenser flow, thus helping to prevent nuisance chiller shutdowns and poor system energy efficiency. The cooling towers included under this service are itemized in the Mechanical Equipment List in this service agreement.

Operating Inspection

Through this service Siemens will help to ensure mechanical equipment continues to operate efficiently, safely and with minimal operating disruptions during the operating season. We will provide routine operating inspection(s) to check system performance in accordance with a program of standard routines as determined by our experience, the equipment manufacturer's published recommendations, equipment application, and location. This service will focus on equipment operation, fluid levels, operating and safety controls, and safe equipment operation. The equipment included under this service is itemized in the Mechanical Equipment List in this service agreement.

Combustion Analysis

Siemens will utilize electronic flue gas analysis to perform combustion analysis, whereby we adjust the burner controls and linkages as required for efficiency and pollution control. If existing equipment cannot meet current pollution requirements, we will make recommendations for system improvements. The boilers included under this service are itemized in the Mechanical Equipment List in this service agreement.

Customer Directed Support

With Customer Directed Support, Siemens will provide a trained and experienced mechanic who will work under your direction. The intent of this service is to offer the labor assistance necessary to complete a special project, or to meet a facility objectives. Specific job responsibilities, goals, work hours and other associated deliverables of this service are listed in the Appendix section of this service agreement.

Eddy Current Testing

Eddy Current Testing helps to ensure heat exchanger tubes are within manufacturer's specifications and tubes are free of defects, thus helping to prevent costly waterside failures. After completion of each test, Siemens shall interpret the results and provide you with a written report including recommendations for corrective action(s). The following systems are covered in the Agreement for chillers itemized in the Mechanical Equipment List:

- Chiller Condenser tubes (once every 2 years)


Vibration Analysis

Many motor and driven component failures are directly related to mechanical failure. Vibration analysis can help you uncover mechanical issues well in advance of a failure and before motors are permanently damaged. As mechanical components begin to wear improperly, equipment begins to vibrate. By analyzing the signature of this vibration, the severity of the issues can be determined as well as the likely cause of the problem. The system combines a powerful diagnostic engine with a straightforward data collection process to analyze and report on specific machine faults and their severity. It provides quantifiable proof of equipment condition that drives budget and investment decisions to repair or replace machinery.

The early detection of mechanical issues can help increase uptime and reduce the overall cost of repairs by identifying issues before they cause major damage. When an issue is identified, plans can be implemented to repair and minimize business interruptions.


Services performed on:

- Pumps
- Air Handler Motors

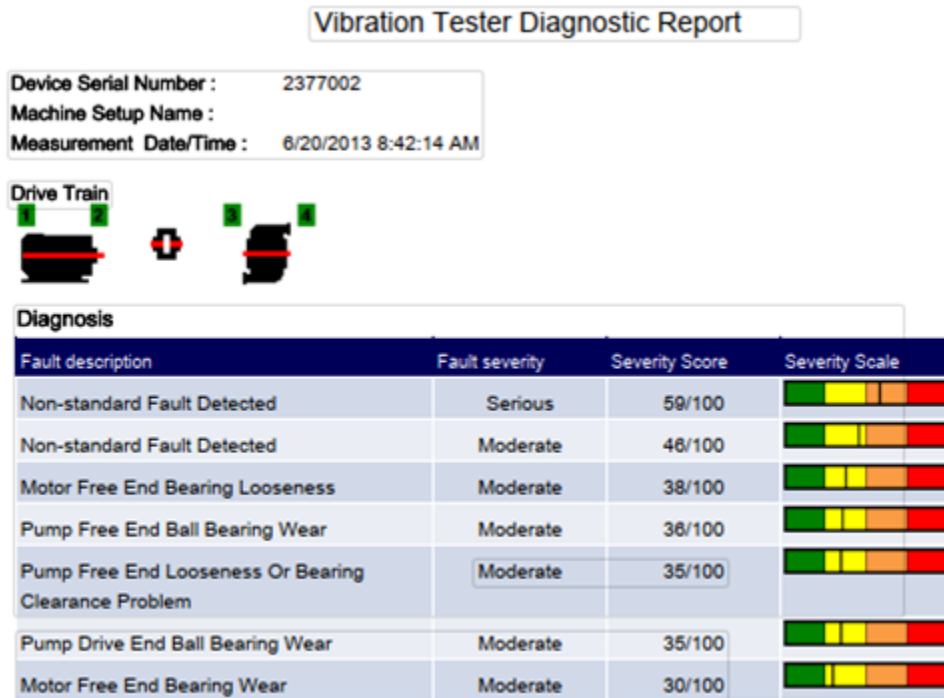

Severity Scale

The Scale is an indication of the severity for any particular fault machine condition.



Follow these recommended actions for each severity level to avoid failure. In general, the scale may be interpreted as:

- **Slight**
No repair action is recommended. Monitor the machine and retest after regular machine planned maintenance to verify maintenance was performed correctly.

- **Moderate**
(Months, even up to a year) – Repair action may be needed in the future. A machine failure is possible, so plan accordingly. Increase the frequency of vibration testing on this equipment and review spare parts availability.

- **Serious**
(Weeks) – Repair action may be needed before the next planned downtime. There may be other physical evidence of the fault in terms of noise or higher bearing temperatures. Retest the machine within a short period to confirm finds. Limit the run time of the machine, if possible, and determine a fault progression trend to prevent additional component failure.

Note:

Time to failure will vary depending on the equipment type, age, machine load, environmental conditions, and other variables.

- **Extreme**
(Days) – Consider shutting down the equipment and tacking repair action **now** to avoid catastrophic failure. There is likely other physical evidence of the fault in terms of noise, higher bearing temperatures or visible movement. Retest the machine within a short period to confirm finds.

Emergency Response Times – Mechanical

Emergency Online/Phone Response

Billable Service

Online system and software troubleshooting and diagnostics and phone support will not be provided under the coverage of this agreement. Siemens will respond to your request for emergency on-line/phone support, Mon-Fri 8:00AM-5:00PM, excluding holidays, upon receiving notification of an emergency, as determined by your staff and Siemens, but all service performed will be provided as a billable service. If remote diagnostics determine a site visit is required to resolve the problem, a technician can be dispatched. Depending on your contract coverage, the on-site dispatch will be covered or will be a billable service call.

Emergency On-site Response

Billable Service

Emergency Onsite Response is not included within the coverage of this agreement. Siemens will respond to your request for emergency on-site service as soon as staff is available. An emergency is determined by your staff and Siemens. All service performed will be provided as a billable service. Siemens will respond to your request for emergency onsite support, Mon-Fri 8:00AM-5:00PM, excluding holidays, upon receiving notification of an emergency, as determined by your staff and Siemens, but all service performed will be provided as a billable service.

Equipment Inventory

Period 4

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
P4	1	1	4	No					No	No

CDS

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
(M) Customer Directed Support	1	4	4	No					No	No

Chiller Plant

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Chiller 1 - Trane	1	4	4	No	TRANE	60	CGWC60	L88L04974	Yes	No
Chiller 2 - Trane	1	4	4	No	TRANE	60	CGWC60	L88L04975	Yes	No
Chiller 3 - Trane	1	4	4	No	TRANE	60	CGWC60	L88L04976	Yes	No
Chiller 4 - Carrier	1	4	4	No	CARRIER	25	30HWB025-C-610EC	1402Q01381	Yes	No
Chiller 5 - Carrier	1	4	4	No	CARRIER	25	30HWB025-C-610EC	1402Q01380	Yes	No
CH Pump 1- PACO	1	4	4	No	PACO	7.5	11-20953-133201		Yes	No

Chiller Plant

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
CH Pump 2- PACO	1	4	4	No	PACO	7.5	Concealed		Yes	No
CH Pump 3- PACO	1	4	4	No	PACO	7.5	Concealed		Yes	No
CH Pump 4- PACO	1	4	4	No	PACO	7.5	Concealed		Yes	No
CH Pump 5 - Kirst Pump	1	4	4	No	KIRST PUMP	5	5BFK1		Yes	No
CW Pump 1- PACO	1	4	4	No	PACO	7.5	Concealed		Yes	No
CW Pump 2- PACO	1	4	4	No	PACO	7.5	Concealed		Yes	No
CW Pump 3- PACO	1	4	4	No	PACO	7.5	Concealed		Yes	No
CW Pump 4 - Frederic	1	4	4	No		5			Yes	No
CW Pump 5 - Weinman	1	4	4	No	WEINMAN	5	167669		Yes	No
Air Tube - Lamson - Incl Basement	2	2	4	No	LAMSON	1	12-SG-75	670357	Yes	No
Air Compressor - Quincy	1	2	4	No	QUINCY	1	BMQTS5QCBDT	UTY951156	Yes	No
Air Dryer - Hankinson	1	2	4	No	HANKINSON	1	HPR5-10-115	H510A1150510 202	Yes	No

Chiller Plant

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
RTU 1 - Carrier	1	1	4	No	CARRIER	5	50HJQ006---511--	2202G49246	Yes	No
RTU 2 - Carrier	1	1	4	No	CARRIER	4	50HS-042---501---	1094G02634	Yes	No
Clean Strainer (Annual)	2	1	4	No					No	No

FCUs

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Fan Coil 1 - Magic Aire	1	4	4	No	MAGIC AIRE	90000	90-BHW-6-A	W991222866	Yes	No
Fan Coil 2 - Magic Aire	1	4	4	No	MAGIC AIRE	90000	90-BHW-6-A	W991222867	Yes	No
Fan Coil 3 - Magic Aire	1	4	4	No	MAGIC AIRE	48000	48-BHW-6-A	W000126023	Yes	No
Fan Coil 4 - Worthington	1	4	4	No	WORTHINGTON	72000	CHN-6.52	28A66F-183	Yes	No
Fan Coil 5 - Worthington	1	4	4	No	WORTHINGTON	72000	CHN-6.52	28A66F-180	Yes	No
Fan Coil 6 - Worthington	1	4	4	No	WORTHINGTON	24000	CHN-2.05	28A66F-169	Yes	No

FCUs

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Fan Coil 7 - Worthington	1	4	4	No	WORTHINGTON	24000	CHN-2.05	28A66F-173	Yes	No
Fan Coil 8 - Worthington	1	4	4	No	WORTHINGTON	48000	CHN-4.62	28A66F-185	Yes	No
Fan Coil 9 - First Co.	1	4	4	No	FIRST CO.	60000	60CHW4-C	J03 part# 88060--4QS	Yes	No
Fan Coil 10 - Worthington	1	4	4	No	WORTHINGTON	72000	CHN-6.52	28A66F-176	Yes	No
Fan Coil 11 - Magic Aire	1	4	4	No	MAGIC AIRE	240000	180/240-BMW-6-A	W040292250	Yes	No
Fan Coil 12 - Magic Aire	1	4	4	No	MAGIC AIRE	240000	180/240-BMW-6-A	W031287599	Yes	No
Fan Coil 13 - Worthington	1	4	4	No	WORTHINGTON	96000	CHV-13.50	64A66G86	Yes	No
Fan Coil 14 - Worthington	1	4	4	No	WORTHINGTON	96000	CHV-13.50	64A66G91	Yes	No
Fan Coil 15 - Worthington	1	4	4	No	WORTHINGTON	96000	CHV-13.50	64A66G-85	Yes	No

FCUs

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Fan Coil 16 - Worthington	1	4	4	No	WORTHINGTON	96000	CHV-13.50	64A66G-83	Yes	No
Fan Coil 17 - Worthington	1	4	4	No	WORTHINGTON	96000	CHV-13.50	64A66G87	Yes	No
Fan Coil 18 - Worthington	1	4	4	No	WORTHINGTON	96000	CHV-13.50	64A66G-84	Yes	No
Fan Coil 19 - UNKNOWN	1	4	4	No		12000			Yes	No

RTUs

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
RTU 1 - Carrier	1	4	4	No	CARRIER	5	50HJQ006---511--	2202G49246	Yes	No
RTU 2 - Carrier	1	4	4	No	CARRIER	4	50HS-042---501---	1094G02634	Yes	No

Split Systems

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Split System 1 - Mitsubishi	1	4	4	No	MITSUBISHI	3.5	PUZ-A42NKA7		Yes	No
Split System 2 - Mitsubishi	1	4	4	No	MITSUBISHI	3.5	PUZ-A42NKA7		Yes	No
Split System 3 - Mitsubishi	1	4	4	No	MITSUBISHI	3.5	PUZ-A42NKA7		Yes	No

Exhaust Fan

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Exhaust Fan RR	1	4	4	No	UNKNOWN	1	UNKNOWN	UNKNOWN	Yes	No

Cooling Tower

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Cooling Tower - BAC	1	4	4	Yes	BAC	145	VTO-145-M	U188617501-01-01	Yes	No

Strip Heaters

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Strip Heaters 1st Floor - 2kw to 15kw	23	1	4	No		34122			Yes	No
Strip Heaters 2nd Floor - 2kw to 7kw	20	1	4	No		17060			Yes	No
Strip Heaters 3rd Floor - 2kw to 6kw	19	1	4	No		13469			Yes	No
Strip Heaters 4th Floor - 2kw to 6kw	17	1	4	No		13469			Yes	No
Strip Heaters 5th Floor - 2kw to 5kw	20	1	4	No		11943			Yes	No

Labor by month

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
User Defined Eqpt. Independent	1	12	4	No					No	No

Chillers

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Chiller 1 -Trane	1	4	4	No	TRANE	80	CGWC80	L87K04982	Yes	No
Chiller 2 -Trane	1	4	4	No	TRANE	80	CGWC80	L87K04983	Yes	No
Clean Strainer (Annual)	2	1	4	No					No	No

Pumps

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
CHW 1 - B&G	1	4	4	No	BELL & GOSSETT	5	UNKNOWN	C052920-01 K70	Yes	No
CHW 2 - B&G	1	4	4	No	BELL & GOSSETT	5	UNKNOWN	C052920-02 K70	Yes	No
CW 1 - B&G	1	4	4	No	BELL & GOSSETT	5	UNKNOWN	CO052921-01 K70	Yes	No
CW 2 - B&G	1	4	4	No	BELL & GOSSETT	5	UNKNOWN	C05292T-02 K70	Yes	No

Split Systems

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Split System 1 - Carrier	1	4	4	No	CARRIER	5	38HDR060 / CK3B060	4306X92236	Yes	No
Split System 2 - Carrier	1	4	4	No	CARRIER	5	38HDR060 / CK3B060	4206X92222	Yes	No
Split System 3 - Carrier	1	4	4	No	CARRIER	1.5	38HDR018 / FK4C018		Yes	No
Split System 4 - Carrier	1	4	4	No	CARRIER	1.5	38QRF018 / 40QAE018		Yes	No
Split System 5 - Mitsubishi	1	4	4	No	MITSUBISHI	1.5	PUY-A30NHA / PLA-A30AA		Yes	No

FCUs

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Fan Coil 1 - Thermal Corp	1	4	4	No	THERMAL CORP	12000	CPE-80-H	07-263906-01	Yes	No
Fan Coil 2 - Thermal Corp	1	4	4	No	THERMAL CORP	12000	CPE-80		Yes	No
Fan Coil 3 - Thermal Corp	1	4	4	No	THERMAL CORP	30000	CPE-150	07-263906-03	Yes	No

FCUs

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Fan Coil 4 - Thermal Corp	1	4	4	No	THERMAL CORP	12000	CPE-80	07-263906-04	Yes	No
Fan Coil 5 - Thermal Corp	1	4	4	No	THERMAL CORP	30000	CPE-150		Yes	No
Fan Coil 6 - Thermal Corp	1	4	4	No	THERMAL CORP	36000	CPE-200	07-263906-06	Yes	No
Fan Coil 7 - Thermal Corp	1	4	4	No	THERMAL CORP	36000	CPE-200	07-263906-07	Yes	No
Fan Coil 8 - Thermal Corp	1	4	4	No	THERMAL CORP	36000	CPE-100	07-263906-08	Yes	No
Fan Coil 9 - Carrier	1	4	4	No	CARRIER	18000	FX4CNF018	1407A70104	Yes	No
Fan Coil 10 - Carrier	1	4	4	No	CARRIER	18000	42DAA16LRDY6YYYY	195011-10-1	Yes	No
Fan Coil 11 - McQuay	1	4	4	No	MCQUAY	60000	CAH006FDAC	FBOU00050000 2	Yes	No
Fan Coil 12 - McLean	1	4	4	No	MCLEAN	60000	NCRM8000	10051590-49	Yes	No

Fans

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Exhaust Fan 1 - Loren Cook	1	4	4	No	LOREN COOK	2	135 CPS		Yes	No
Exhaust Fan 2 - Loren Cook	1	4	4	No	LOREN COOK	2	135 ACRUB		Yes	No
Exhaust Fan 3 - Loren Cook	1	4	4	No	LOREN COOK	3	150 CPS	138S988039-01 /0002101	Yes	No
Exhaust Fan 4 - Loren Cook	1	4	4	No	LOREN COOK	7.5	245 CPS	138S988039-01 /0003501	Yes	No
Exhaust Fan 5 - Loren Cook	1	4	4	No	LOREN COOK	5	210 SQNB		Yes	No
Exhaust Fan 6 - Loren Cook	1	4	4	No	LOREN COOK	5	GC-220		Yes	No
Exhaust Fan 7 - Loren Cook	1	4	4	No	LOREN COOK	1	100 CPS	138S948902-00 /0000701	Yes	No
Exhaust Fan 8 - Loren Cook	1	4	4	No	LOREN COOK	1	100 CPS	138S938097-00 /0002101	Yes	No
Exhaust Fan 9 - Loren Cook	1	4	4	No	LOREN COOK	3	150 ACRUB	138S936258-01 /0012404	Yes	No
Exhaust Fan 10 - UNKNOWN	1	4	4	No	UNKN OWN	5			Yes	No
Supply Fan 1 - Loren Cook	1	4	4	No	LOREN COOK	5	180 KSP-B	138S988039-00 /0000701	Yes	No
Supply Fan 2 - Loren Cook	1	4	4	No	LOREN COOK	3	150 ASP	138S988039-00 /0001801	Yes	No

Fans

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Gun Range Exhaust - Dayton	1	4	4	No	DAYTON	5	1M8F2	15104289	Yes	No

AHUs

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Air Handler 1 - Thermal Corp	1	4	4	Yes	THERMAL CORP	50	RTA-701-H	09-263906-09	Yes	No
Air Handler 2 - Thermal Corp	1	4	4	Yes	THERMAL CORP	50	RTA-241-HS	09-263906-10	Yes	No

Boilers

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Boiler 1 - Raypak	1	4	4	No	RAYPAK INC.	60	302-902	704264547	Yes	No
Boiler 1 - Raypak	1	4	4	No	RAYPAK INC.	60	302-902	704264548	Yes	No

HWPs

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Hot Water Pump 1 - Bell & Gossett	1	4	4	No	BELL & GOSSETT	5	1BF046 E70		Yes	No
Hot Water Pump 2 - Bell & Gossett	1	4	4	No	BELL & GOSSETT	5	1BF046 E70		Yes	No

Cooling Tower

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
Cooling Tower - BAC	1	4	4	Yes		160	FXT-160/X	U15634601-01	Yes	No

Labor by month

Description	Qty	# of Visits	# of Years	VFD Incl.	Manufacturer	Size (Tons /HP)	Model #	Serial #	Preventive Maintenance	R&R Service
User Defined Eqpt. Independent	1	12	4	No					No	No

Exclusions and Clarifications

Unless expressly stated otherwise, Services do not include and Siemens is not responsible for: (a) re-installation or relocation of Equipment; (b) painting or refinishing of Equipment or surrounding surfaces; (c) parts, accessories, attachments or other devices added to Equipment but not furnished by Siemens; (d) failure to continually provide suitable operating environment including, but not limited to, adequate space, ventilation, electrical power and protection from the elements; (e) the removal or re-installation of replacement valves, dampers, water flow and tamper switches, airflow stations, venting or draining systems, and any other permanently mounted integral pipe or air duct component; (f) installation / removal, and / or rental fees for any temporary HVAC equipment if necessary; (g) Cranes, hoisting or rigging that may be required; (h) Leaks at gaskets O-rings or seals; or (i) latent defects in the Equipment that cannot be discovered through the standard provision of the Services. Siemens is not responsible for services performed on any Equipment other than by Siemens or its agents.

Siemens is not responsible for service calls due to power outages.

Siemens is not responsible for repair labor/materials/parts for covered equipment that has experienced electrical damage due to power surges, single phasing, and related electrical issues.

Siemens will not be responsible for the maintenance, repair or replacement of, or Services necessitated by reason of: (a) non-maintainable, non-replaceable or obsolete parts of the Equipment, including but not limited to ductwork, shell and tubes, heat exchangers, coils, unit cabinets, casings, refractory material, electrical wiring, water and pneumatic piping, structural supports, cooling tower fill, slats and basins, etc. unless otherwise expressly stated elsewhere in this Proposal; or (b) negligence, abuse, misuse, improper or inadequate repairs or modifications by others, improper operation, lack of operator maintenance or skill, failure to comply with manufacturer's operating and environmental requirements.

Siemens is not responsible for repairs, replacements, or services to Equipment due to corrosion, erosion, improper or inadequate water treatment by others, electrolytic or chemical action, or reasons beyond its reasonable control.

Siemens is not responsible for water treatment related damages to the condenser, evaporator, hot water, or steam systems.

Siemens is not responsible for repair labor/materials/parts for ice machines, refrigerators, freezers, kitchen specialty equipment, boilers, laundry equipment, replacement refrigerant, replacement glycol, or replacement control valves unless included elsewhere. On occasion a flush and refill of the Water-Glycol mixtures may be required. Flush and refill is not included in the standard service offering.

Siemens is not responsible for helium replacement in chiller systems that service Medical Imaging Systems.

Connectivity and Communications

Siemens Service Portal

The Service Portal complements the personalized services you will receive from your local Siemens office by providing greater visibility into equipment and services delivered by Siemens. This web-based portal allows you the ability to submit service requests, confirm and modify schedules, track repairs, manage agreements, generate reports, and access critical information; then share it across your entire enterprise quickly and efficiently. The Service Portal is a user-friendly way to increase your productivity and the value of your service program.

Data security as a basic requirement

We value confidentiality and long-term partnerships. That is why we give the security of your data the highest priority. Before we implement an enhanced service package with remote support, we conduct an in-depth analysis of the situation, taking into account national and international regulations, technical infrastructures and industry specifics. Our service employees carefully evaluate your needs on an individual basis with a view toward information security.

Service Agreement Contract Characteristics

Description	AUTOMATION	MECHANICAL
Hours of Coverage	Mon-Fri, 8:00 AM - 5:00 PM	Mon-Fri, 8:00 AM - 5:00 PM
Response Times (Phone/Online)	Billable	Billable
Response Times (Onsite/Emergency)	Billable	Billable
Remote Services	Yes	No
Third Party Systems	No	No
Monitoring	No	No

Equipment Related Services

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
Chiller 1 - Trane						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Condenser Tube Cleaning (water)	1	1	1,2,3,4	Onsite	N/A
	Eddy Current Analysis	1	1	3	Onsite	N/A
Chiller 2 - Trane						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Condenser Tube Cleaning (water)	1	1	1,2,3,4	Onsite	N/A
	Eddy Current Analysis	1	1	3	Onsite	N/A
Chiller 3 - Trane						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Condenser Tube Cleaning (water)	1	1	1,2,3,4	Onsite	N/A
	Eddy Current Analysis	1	1	3	Onsite	N/A
Chiller 4 - Carrier						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Condenser Tube Cleaning (water)	1	1	1,2,3,4	Onsite	N/A
	Eddy Current Analysis	1	1	3	Onsite	N/A
Chiller 5 - Carrier						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Condenser Tube Cleaning (water)	1	1	1,2,3,4	Onsite	N/A
	Eddy Current Analysis	1	1	3	Onsite	N/A
CH Pump 1- PACO						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CH Pump 2- PACO						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CH Pump 3- PACO						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
CH Pump 4- PACO						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CH Pump 5 - Kirst Pump						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CW Pump 1- PACO						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CW Pump 2- PACO						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CW Pump 3- PACO						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CW Pump 4 - Frederic						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CW Pump 5 - Weinman						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
Air Tube - Lamson - Incl Basement						
	Annual Inspection	2	1	1,2,3,4	Onsite	N/A
	Operational Inspection	2	1	1,2,3,4	Onsite	N/A
Air Compressor - Quincy						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	1	1,2,3,4	Onsite	N/A
Air Dryer - Hankinson						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	1	1,2,3,4	Onsite	N/A
RTU 1 - Carrier						

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
	Belt Service	1	1	1,2,3,4	Onsite	N/A
	Coil Cleaning - Condenser (Refrig)	1	4	1,2,3,4	Onsite	N/A
RTU 2 - Carrier						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
	Belt Service	1	1	1,2,3,4	Onsite	N/A
	Coil Cleaning - Condenser (Refrig)	1	4	1,2,3,4	Onsite	N/A
Fan Coil 1 - Magic Aire						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 2 - Magic Aire						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 3 - Magic Aire						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 4 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 5 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 6 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 7 - Worthington						

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 8 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 9 - First Co.						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 10 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 11 - Magic Aire						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
Fan Coil 12 - Magic Aire						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 13 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 14 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 15 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 16 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 17 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 18 - Worthington						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 19 - UNKNOWN						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Split System 1 - Mitsubishi						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	1	1,2,3,4	Onsite	N/A
Split System 2 - Mitsubishi						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	1	1,2,3,4	Onsite	N/A
Split System 3 - Mitsubishi						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	1	1,2,3,4	Onsite	N/A
Exhaust Fan RR						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Cooling Tower - BAC						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Cooling Tower Cleaning	1	1	1,2,3,4	Onsite	N/A
	Belt Service	1	1	1,2,3,4	Onsite	N/A
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Cooling Tower Cleaning	1	1	1,2,3,4	Onsite	N/A
	Belt Service	1	1	1,2,3,4	Onsite	N/A
Strip Heaters 1st Floor - 2kw to 15kw						

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Annual Inspection	23	1	1,2,3,4	Onsite	N/A
Strip Heaters 2nd Floor - 2kw to 7kw						
	Annual Inspection	20	1	1,2,3,4	Onsite	N/A
Strip Heaters 3rd Floor - 2kw to 6kw						
	Annual Inspection	19	1	1,2,3,4	Onsite	N/A
Strip Heaters 4th Floor - 2kw to 6kw						
	Annual Inspection	17	1	1,2,3,4	Onsite	N/A
Strip Heaters 5th Floor - 2kw to 5kw						
	Annual Inspection	20	1	1,2,3,4	Onsite	N/A
Chiller 1 -Trane						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Condenser Tube Cleaning (water)	1	1	1,2,3,4	Onsite	N/A
	Eddy Current Analysis	1	1	3	Onsite	N/A
Chiller 2 -Trane						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Condenser Tube Cleaning (water)	1	1	1,2,3,4	Onsite	N/A
	Eddy Current Analysis	1	1	3	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
CHW 1 - B&G						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CHW 2 - B&G						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CW 1 - B&G						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
CW 2 - B&G						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
Split System 1 - Carrier						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Split System 2 - Carrier						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Split System 3 - Carrier						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Split System 4 - Carrier						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Split System 5 - Mitsubishi						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 1 - Thermal Corp						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 2 - Thermal Corp						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 3 - Thermal Corp						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 4 - Thermal Corp						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 5 - Thermal Corp						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 6 - Thermal Corp						

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 7 - Thermal Corp						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 8 - Thermal Corp						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 9 - Carrier						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 10 - Carrier						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
Fan Coil 11 - McQuay						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Fan Coil 12 - McLean						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
Exhaust Fan 1 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Exhaust Fan 2 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Exhaust Fan 3 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Exhaust Fan 4 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Exhaust Fan 5 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Exhaust Fan 6 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Exhaust Fan 7 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Exhaust Fan 8 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Exhaust Fan 9 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Exhaust Fan 10 - UNKNOWN						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
Supply Fan 1 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Supply Fan 2 - Loren Cook						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Gun Range Exhaust - Dayton						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
Air Handler 1 - Thermal Corp						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
	Belt Service	1	1	1,2,3,4	Onsite	N/A
Air Handler 2 - Thermal Corp						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Air Filter Service	1	4	1,2,3,4	Onsite	N/A
	Belt Service	1	1	1,2,3,4	Onsite	N/A

Mechanical

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
Boiler 1 - Raypak						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Combustion Analysis	1	1	1,2,3,4	Onsite	N/A
	Combustion Analysis	1	1	1,2,3,4	Onsite	N/A
Hot Water Pump 1 - Bell & Gossett						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A
Hot Water Pump 2 - Bell & Gossett						
	Annual Inspection	1	1	1,2,3,4	Onsite	N/A
	Operational Inspection	1	3	1,2,3,4	Onsite	N/A
	Vibration Analysis	1	1	1,2,3,4	Onsite	N/A

Automation

Equipment	Service Description	Qty	Frequency	Year	Service Location	Repair Coverage
City Hall Panels on P2 BLN						
	Apogee System	2	1	1,2,3,4	Onsite	N/A
PHQ Legacy Panels on P2 BLN						
	Apogee System	3	1	1,2,3,4	Onsite	N/A
PHQ Panel on P2 BLN						
	Apogee System	1	1	1,2,3,4	Onsite	N/A

Service Team

An important benefit of your Service Agreement derives from having the trained building service personnel of Siemens Industry, Inc. familiar with your building systems. Our implementation team of local experts provides thorough, reliable service and scheduling for the support of your system.

Added to the team is a team of building experts at our Digital Service Center. The benefits you receive are less disruption to your employees at the site, less intrusive on the system at peak hours, fewer emissions for trucks rolled, and real time analytics with digital workspace hours.

The following list outlines the service team that will be assigned to the service agreement for your facility

Your Assigned Team of Service Professionals will include:

Sales Executive manages the overall strategic service plan based upon your current and future service requirements.

Remote Services Specialist is responsible for the execution of remote services including proactive planned tasks, in-depth fault analysis and identification of corrective actions.

Client Services Manager is responsible for ensuring that our contractual obligations are delivered, your expectations are being met and you are satisfied with the delivery of our services.

Service Operations Manager is responsible for managing the delivery of your entire support program and service requirements.

Primary Service Specialist is responsible for performing the ongoing service of your system.

Service Coordinator is responsible for scheduling your planned maintenance visits, and handling your emergency situations by taking the appropriate action.

Secondary Service Specialist who will be familiarized with your building systems to provide in-depth backup coverage.

Service Administrator is responsible for all service invoicing including both service agreement and service projects.

Siemens Terms of Sale (STS)

Terms of Sale (Click to download)

[Base Terms](#)

THIS PURCHASE IS MADE IN ACCORDANCE WITH THE GROUP COOPERATIVE SOURCEWELL CONTRACT #121024-SIE. ALL TERMS OF SUCH SOURCEWELL CONTRACT ARE INCORPORATED HEREIN, AND THE TERMS AND CONDITIONS WILL PREVAIL EXCLUSIVELY OVER THE TERMS OF THE PURCHASE ORDER AND/OR CUSTOMER AGREEMENT. NO FEDERAL TERMS AND CONDITIONS, FEDERAL FUNDS, OR GRANTS ARE APPLICABLE TO THIS ORDER.

Price Escalation. If, during the term of this Contract, the price of various materials or labor or logistics are increased as reflected by CRU, CMAI, COMEX market indexes or IHS Markit, then Siemens may increase the applicable yearly Investment or apply a surcharge accordingly.

To the extent applicable, the following Supplements are incorporated and made part of the Siemens Terms of Sale:

Click on supplement(s) below to read/download

[Services Supplemental Terms](#)

Siemens reserves the right to adjust prices to reflect the impact of any new or modified taxes, duties, tariffs, or equivalent measures, whether direct or indirect, imposed by any U.S. or foreign governmental authority that are applicable to the Offerings, including any hardware, software, or service components contained therein.

Siemens is entitled to amend these terms and conditions at any time without prior notice. Previous and Retired versions of Base Terms & Supplemental Terms can be found here: www.siemens.com/terms-of-sale

Agreement Terms for Investments

Services shall be provided at:

77 FAIR DR
COSTA MESA, CA 92626-6520

Siemens Industry, Inc. shall provide the services as identified in this Proposal and pursuant to the associated terms and conditions contained within.

Initial Term Investments:

Period	Period Range	Billing Frequency	Annual Price
1	Jul 1,2026 - Jun 30,2027	Annually (In Advance)	\$259,817.00
2	Jul 1,2027 - Jun 30,2028	Annually (In Advance)	\$275,406.00
3	Jul 1,2028 - Jun 30,2029	Annually (In Advance)	\$308,014.00
4	Jul 1,2029 - Jun 30,2030	Annually (In Advance)	\$309,441.00
Multi-Period Investment Total			\$1,152,678.00*

Amount Due In Advance Based On Billing Frequency

*** This proposal is a firm fixed price ***

Sourcewell Account: City of Costa Mesa
Account # 2173

All billable/emergency services and service/maintenance calls will be performed outside of the Sourcewell contract under a separate order.

Estimated sales taxes have been included in the investment amount. The exact amount will be calculated based on local requirements at the time of invoicing. The pricing quoted in this Proposal are firm for 30 days.

Siemens Industry, Inc. invoices paid by credit card may be subject to a surcharge of up to 2%.

**Siemens reserves the right to adjust prices to reflect the impact of any new or modified taxes, duties, tariffs, or equivalent measures, whether direct or indirect, imposed by any U.S. or foreign governmental authority that are applicable to our offering, including any hardware, software, or service components contained therein.*

Signature Page

The Buyer acknowledges that when accepted by the Buyer as proposed by Siemens Industry, Inc., this Proposal and the Standard Terms and Conditions of Sale for Services, (together with any other documents, including any applicable Rider(s), incorporated herein) shall constitute the entire agreement of the parties with respect to its subject matter.

BY EXECUTION HEREOF, THE SIGNER CERTIFIES THAT (S)HE HAS READ ALL OF THE TERMS AND CONDITIONS AND DOCUMENTS, THAT SIEMENS INDUSTRY, INC. OR ITS REPRESENTATIVES HAVE MADE NO AGREEMENTS OR REPRESENTATIONS EXCEPT AS SET FORTH THEREIN, AND THAT (S)HE IS DULY AUTHORIZED TO EXECUTE THE SIGNATURE PAGE ON BEHALF OF THE BUYER.

Initial Term Investments

Period	Period Range	Billing Frequency	Annual Price
1	Jul 1,2026 - Jun 30,2027	Annually (In Advance)	\$259,817.00
2	Jul 1,2027 - Jun 30,2028	Annually (In Advance)	\$275,406.00
3	Jul 1,2028 - Jun 30,2029	Annually (In Advance)	\$308,014.00
4	Jul 1,2029 - Jun 30,2030	Annually (In Advance)	\$309,441.00

Proposed by:

Siemens Industry, Inc.

Company

Kris Gilmour

Name

10550946

Proposal #

\$1,152,678.00

Proposal Amount

May 11, 2026

Date

Accepted by:

CITY OF COSTA MESA

Company

Name (Printed)

Signature

Title

Date

Purchase Order # PO for billing/pmnt only PO not required

Siemens Service Portfolio

Advisory and Performance Services



Manage System Operation & Compliance

Services that keep systems performing at their best, as designed and intended to operate, help you achieve:

- Optimized comfort, safety, and security
- Fulfilled regulatory requirements
- Greater transparency into critical systems
- Reduced operating risk

Facility Assessment & Planning
In-depth building system assessment and recommendations, definition of relevant KPIs, and development of your service program

Test & Inspection
Regular check-ups to measure system performance compared to your defined facility and regulation requirements and risks

Preventive Services
Services performed on a regular schedule or based on data analytics to verify and improve system state

Documentation Management
Management of critical building system and compliance information, with organization and access determined by your needs

Corrective Services
Immediate response to system failures or faults to restore functionality and integrity to desired state



Optimize Performance & Productivity

Enhance building performance with improvement measures that increase productivity and efficiency; common outcomes include:

- Enhanced system performance
- Streamlined operational processes
- Improved decision-making through data analytics

Optimization Planning
Planning and prioritization of improvement measures to increase building and/or process performance and efficiencies

Predictive Services
Systems are audited and monitored to detect abnormalities or faults, with recommendations provided and/or corrective actions taken

System Improvements & Integration
Enhancements or additions to your current system to increase staff productivity, system performance, and operational/energy efficiencies

Training & Operational Support
Training, coaching, and on-site support to increase staff productivity and knowledge

Managed Services
On-site and/or remote resources monitor system events and alarms, and take appropriate action



Protect Lifecycle Investment

Leverage past investments and address future requirements with advanced and proven technology, to achieve outcomes such as:

- Extended system life
- Maximized return on investment
- Realized benefits of new technology

Technology Planning
Consulting services identify technology improvement opportunities that help achieve performance goals while leveraging past investments

System Updates / Upgrades
Software upgrades and firmware updates are provided, delivering the most current technology and functionality

System Migration / Modernization
Enhancements to your systems by elevating them to the most current hardware and software platforms, resulting in increased functionality and performance levels

Retrofits & Extensions
Modifications are made to existing systems to accommodate changes to your facility usage and footprint

New Installation Services
Startup, commissioning, and other installation services are completed to ensure new equipment operates at maximum performance



Enhance Energy Management & Sustainability

Increase the value and competitiveness of buildings and infrastructure by delivering solutions that:

- Conserve energy
- Maximize efficiency
- Minimize operating costs
- Reduce environmental impact

Energy & Sustainability Master Planning
Strategy and planning services provide a detailed master plan to provide budget transparency, enable improved performance and sustainability, reduce energy consumption, and minimize operational costs

Energy Conservation
Implementing energy conservation strategies reduces total carbon emissions through efficiency measures and minimizes energy spend by optimizing consumption

Energy Production & Storage
Using innovative design and simulation tools, energy production and storage solutions improve energy efficiency, energy availability, security of supply, and carbon reduction

Energy Procurement
With advanced procurement technologies and beneficial contract terms, these tailored procurement and supply services reduce costs, reduce risks, and create certainty

Digital Services